




Color: ■

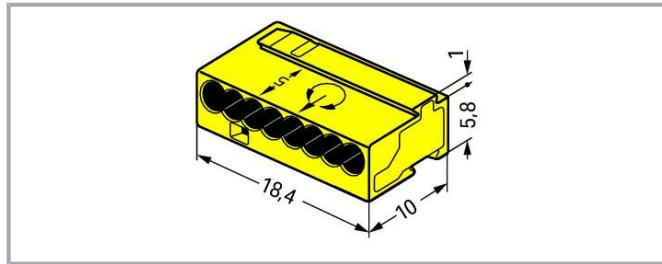

## Data

### Electrical data

### Ratings per IEC/EN

Ratings per	EN 60664
Nominal voltage (II/2)	100 V
Rated surge voltage (II/2)	1.5 kV
Rated current	6 A
Legend (ratings)	(II / 2) ≤ Overvoltage category II / Pollution degree 2

### Connection data

Connection points	8
Total number of potentials	1
Number of connection types	1
Number of levels	1

### Connection 1

Connection technology	PUSH WIRE®
-----------------------	------------

Subject to changes. Please also observe the further product documentation!

Actuation type	Push-in
Connectable conductor materials	Copper
Solid conductor	22 ... 20 AWG
Conductor diameter	0.6 ... 0.8 mm / 22 ... 20 AWG
Conductor diameter (note)	When using conductors of the same diameter, 0.5 mm (24 AWG) or 1 mm (18 AWG) diameters are also possible.
Strip length	5 ... 6 mm / 0.2 ... 0.24 inches
Wiring direction	Side-entry wiring

## Physical data

Width	18.4 mm / 0.724 inches
Height	6.8 mm / 0.268 inches
Depth	10 mm / 0.394 inches

## Material data

### Note (material data)

Information on material specifications can be found here

Color	yellow
Cover color	light gray
Fire load	0.019 MJ
Weight	1.4 g

## Environmental requirements

Ambient temperature (operation)	+60 °C
Continuous operating temperature	105 °C

## Commercial data

eCl@ss 10.0	27-14-11-04
eCl@ss 9.0	27-14-11-04
ETIM 8.0	EC000446
ETIM 7.0	EC000446
PU (SPU)	500 (50) pcs
Packaging type	box
Country of origin	DE
GTIN	4044918502726
Customs tariff number	85369010000

Subject to changes. Please also observe the further product documentation!

## Environmental Product Compliance

RoHS Compliance Status

Compliant, No Exemption

## Approvals / Certificates

### General approvals

Logo	Approval	Additional Approval Text	Certificate name
	CCA DEKRA Certification B.V.	EN 60998	NTR NL 7812
	CSA DEKRA Certification B.V.	C22.2	70048857
	KEMA/KEUR DEKRA Certification B.V.	EN 60998	71- 112493
	UR Underwriters Laboratories Inc.	UL 1059	E45172

### Declarations of conformity and manufacturer's declarations

Logo	Approval	Additional Approval Text	Certificate name
	EU-Declaration of Conformity WAGO GmbH & Co. KG	-	-
	UK-Declaration of Conformity WAGO GmbH & Co. KG	-	-

### Approvals for marine applications

Logo	Approval	Additional Approval Text	Certificate name
	ABS American Bureau of Shipping	-	18- HG1755093- PDA

Subject to changes. Please also observe the further product documentation!



LR  
Lloyds Register



EN 60998

LR22207029TA

## Optional accessories

### Marking accessories

#### Marking strip



**Item no.: 210-332/575-103**

Marking strips; as a DIN A4 sheet; MARKED; 1-12 (160x); Height of marker strip: 3 mm; Strip length 182 mm; Horizontal marking; Self-adhesive; white

[www.wago.com/210-332/575-103](http://www.wago.com/210-332/575-103)

#### Mounting adapter

##### Mounting accessories



**Item no.: 243-112**

Mounting carrier; for 4 connectors; 243 Series; for DIN-35 rail mounting/screw mounting; orange

[www.wago.com/243-112](http://www.wago.com/243-112)



**Item no.: 243-113**

Mounting carrier; for 6 connectors; 243 Series; for DIN-35 rail mounting/screw mounting; orange

[www.wago.com/243-113](http://www.wago.com/243-113)

## Downloads

### Documentation

#### Bid Text

243-508	2019 Feb 19	xml	<a href="#">Download</a>
X81 - Datei		3.3 kB	
243-508	2017 May 17	doc	<a href="#">Download</a>
doc - Datei		25.6 kB	

[ausschreiben.de 243-508](#) [URL](#) [Download](#)

## CAD/CAE-Data

### CAE data

EPLAN Data Portal 243-508	<a href="#">URL</a>	<a href="#">Download</a>
---------------------------	---------------------	--------------------------

Subject to changes. Please also observe the further product documentation!

WSCAD Universe 243-508

URL

Download

CAD data

2D/3D Models 243-508

URL

Download

Asset Administration Shell

Asset Administration Shell 243-508

URL

Download

## Environmental Product Compliance

Compliance Search

Environmental Product Compliance 243-508


URL

Download


MICRO PUSH WIRE® connector for junction boxes; for solid conductors; max. 0.8 mm Ø; 8-conductor; light gray cover; Surrounding air temperature: max 60°C; yellow

## Installation Notes

Conductor termination

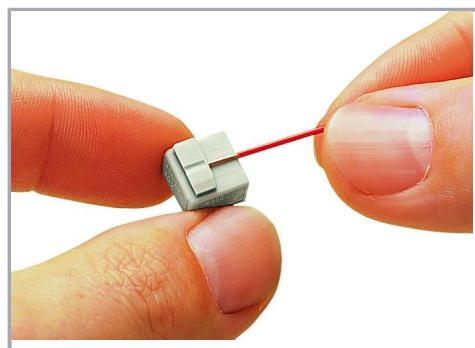

Strip solid conductors to 5 ... 6 mm (0.19 ... 0.23 inch).

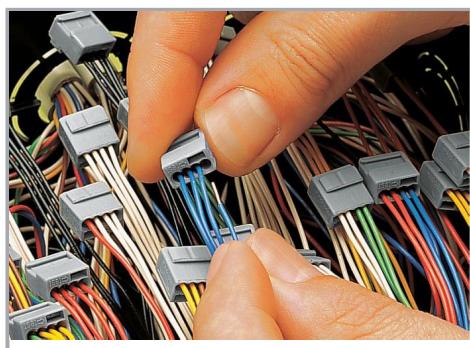

Termination: Insert the stripped solid conductor until it hits the backstop.

Subject to changes. Please also observe the further product documentation!

WAGO GmbH & Co. KG

Hansastr. 27


32423 Minden

Phone: +49571 887-0 | Fax: +49571 887-169

Email: [info.de@wago.com](mailto:info.de@wago.com) | Web: [www.wago.com](http://www.wago.com)

Do you have any questions about our products?

We are always happy to take your call at +49 (571) 887-44222.

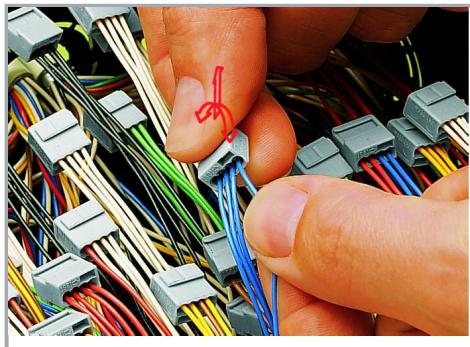

Removal: Hold conductor to be removed and twist alternately left and right while pulling the connector.

#### Installation



#### Connector strips:

Assembling modular connectors into connector strips.

#### Commoning




Commoned connector strips

#### Testing

Subject to changes. Please also observe the further product documentation!



Testing via test port opposite to conductor entry.

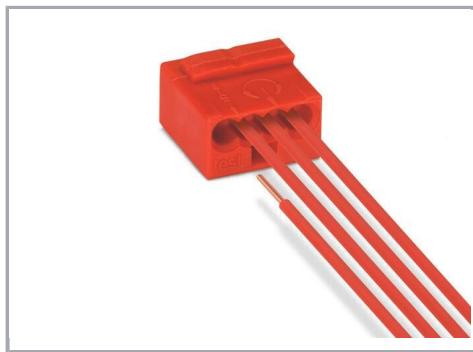

The 243 Series can be used in both communication and alarm systems according to the VdS (German Association of Property Insurers) guidelines.

No general approval is given to PUSH WIRE® connectors by the VdS association. The connectors must be tested together with the different parts of the system.

The requirements for connectors are specified in the VdS guidelines for junction boxes (VdS 2116) in section 8.7: "The junction box connectors must be designed to guarantee a reliable and stable connection."

The verification of the fulfillment of these requirements is documented in the VDE test report No. 2574-1440-4031 for the insulated 243 Series PUSH WIRE® Connectors.

Subject to changes. Please also observe the further product documentation!